



# CS 2004™


By CSI Controls

## NEMA 4X Alarm • Installation Instructions

<b>⚠ WARNING</b> 	<b>ELECTRICAL SHOCK HAZARD</b> Disconnect power before installing or servicing this product. A qualified service person must install and service this product according to applicable electrical and plumbing codes.	<b>⚠ WARNING</b> 	<b>EXPLOSION OR FIRE HAZARD</b> Do not use this product with flammable liquids. Do not install in hazardous locations as defined by National Electrical Code, ANSI/NFPA 70.
Failure to follow these precautions could result in serious injury or death. Replace product immediately if switch cable becomes damaged or severed. Keep these instructions with warranty after installation. This product must be installed in accordance with National Electric Code, ANSI/NFPA 70 so as to prevent moisture from entering or accumulating within boxes, conduit bodies, fittings, float housing, or cable.			

### Alarm and Float Installation

1. Decide mounting location.
2. Install the unit using the built-in mounting feet.
3. Hook the 120 VAC plug into a 120 VAC receptacle on a separate branch circuit from the one used for the pump to ensure proper notification.
4. Now manually test the alarm by tilting the float switch up until you hear the alarm notification and you see the alarm light turn on. Mount the float switch using a proper float mounting clamp or cord weight.
5. Periodically test unit by touching the cover of the enclosure where indicated twice within 1.5 seconds of each touch to make sure the unit is working properly. Make sure to use your entire flat hand against the area inside the red rectangle. (Touch once to silence – Touch twice to test.)



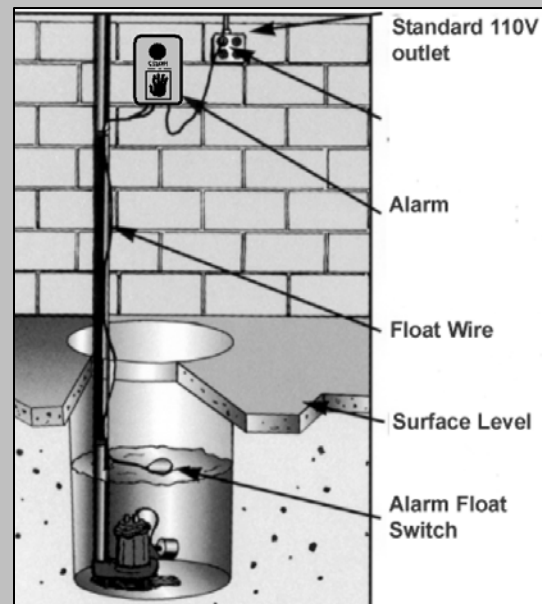


Typical Installation

**CSI** controls™

REV.	BY	DATE	DETAILS

NOTES:  
 - ALL WIRES, UNLESS SPECIFIED OTHERWISE, ARE TO BE 22 AWG.

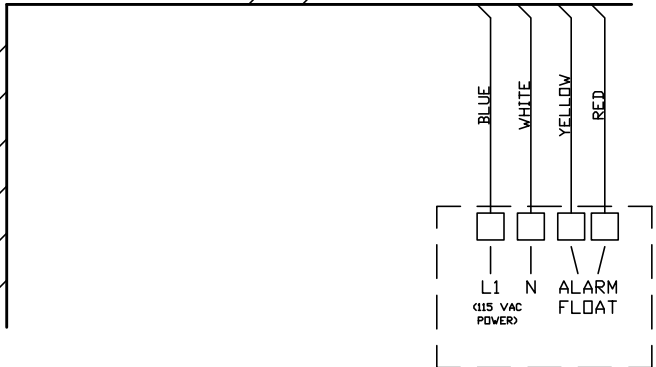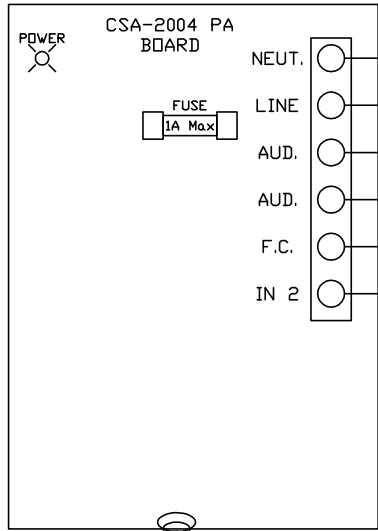

THIS DRAWING IS THE PROPERTY OF CHANDLER SYSTEMS, INC. AND IT OR THE TECHNOLOGY CONTAINED HEREIN MAY NOT BE REPRODUCED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF CHANDLER SYSTEMS, INC.



OUTDOOR 2004 ALARM WIRING DIAGRAM FOR OUTDOOR ALARM

DRWN.	DATE	SCALE	N/A
ARW	8/15/05	DRWG. NO.	CS-2004